


## WaveLinx Connected Lighting

# Conference Room

## example 2



IECC 2018	*	*	*	*	*	*	*	*	*
ASHRAE 90.1 - 2019	*	*	*	*	*	*	*	*	*
T24 2019	*	*	*	*	*	*	*	*	*
NECB 2017	*	*	*	*	*	*	*	*	*

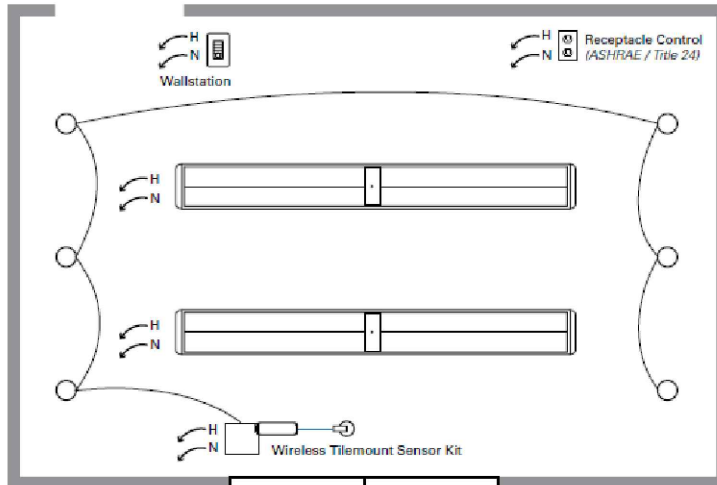

### Sequence of Operations

#### Lighting

- 0-10V lighting loads
- Up to 3 dimmable zones
- Out of the box 75% high end trim
- Individually addressable luminaires (IECC)

#### Occupancy

- Automatic auto on to 50%
- Optional vacancy mode
- Optional auto on to scene
- Plug load turns on with occupancy
- Automatic off of lighting and plug load on vacancy

#### Daylighting

- Continuous dimming to off
- Individual luminaire daylight dimming to approximately 500 lux
- Daylighting not required for indoor spaces without windows
- Not required in spaces without windows or that are less than 150W (120W for ASHRAE / Title 24)

#### Manual Controls

- Programmable Scenes
- Remaining buttons trigger scenes
- Scene raise / Scene lower
- All off

#### Additional Features


- Energy calculations (available through Trellix)
- Automatic demand response through wireless area controller
- Scheduling of partial off light levels from wireless area controller
- UL924 emergency control capabilities via luminaire battery backup or fixture integrated transfer device (consult fixture spec sheet)
- Complies with Enhanced Digital Lighting Control section C406 (IECC)

### Bill of Material

Quantity	Catalog #	Description
1	WAC-POE	Wireless Area Controller
1	W4S-RL-W	WaveLinx Wallstation
1	WR-20	WaveLinx Receptacle (ASHRAE / Title 24)
1	WTA	WaveLinx Tilemount Sensor Kit
6	LD4 or LD6	Portfolio Commercial Recessed LED
2	DSI-WS-40L835-1D-UNV-STD-WAA-DC-W-AC48-T1-8	Divide Suspended with WaveLinx Sensor

Design Consideration	Best Practice	Maximum
Gateway / Wireless Area Controller range	150 ft LOS	300 ft LOS
Number of interior walls	2 walls	3 walls
Distance from Wireless Area Controller to 1st WaveLinx device	150 ft	200 ft
Distance between WaveLinx devices	75 ft	150 ft
Number of hops from Wireless Area Controller	4 hops	5 hops
Number of areas per Wireless Area Controller	15 + 1 construction area	
Number of zones per area	3	16
Number of scenes per area	16	16

### Typical Wiring Detail

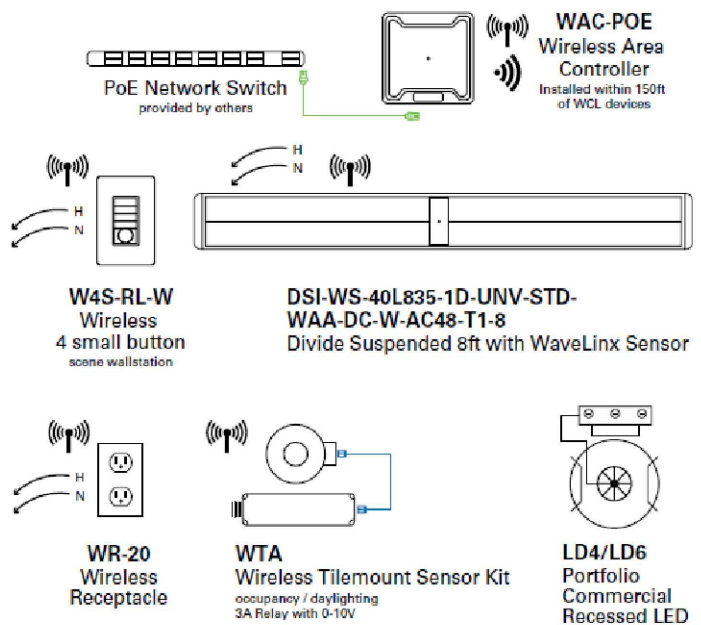

	Local Control	Manual ON	Partial ON	Bilevel Lighting	Daylight Side	Daylight Top	Partial OFF	Automatic OFF	Scheduled OFF	Receptacle Control	Energy Monitoring	Parking Garage	Functional Testing	Demand Response	Enhanced Digital
IECC 2018	C405.2.5	C405.2.5	C405.2.2.1.2		C405.2.3.2	C405.2.3.3	C405.2.1.3	C405.2.1.1.1	C405.2.2	C405.2.4		C405.2.6	C408.3		C406.4
ASHRAE 90.1-2019	9.4.1 (a)	9.4.1.1 (b)	9.4.1.1 (c)	9.4.1.1 (d)	9.4.1.1 (e)	9.4.1.1 (f)	9.4.1.1 (g)	9.4.1.1 (h)	9.4.1.1 (i)	8.4.2	8.4.3.2	9.4.1.2	9.4.3		C406.4
T24 2019	130.1 (a)(b)	130.1 (a)(b)	130.1 (b)		130.1 (d)	130.1 (d)	130.1 (c).6	130.1 (c).5	130.1 (c)	130.5 (d)	130.5 (b)	130.1 (d)	130.4	130.1 (e) 130.1 (e)	
NECB 2017	4.2.2.1.(3)	4.2.2.1.(3) 4.2.2.1.(6)	4.2.2.1.(8)	4.2.2.1.(9)	4.2.2.1.(10)	4.2.2.1.(18)	4.2.4.1. (16-17)	4.2.2.1. (18-19)	4.2.2.1. (20-23)			4.2.2.2 4.2.2.4			